


2-WAY TEST TEE (EDGE OF PROPERTY) PROFILE

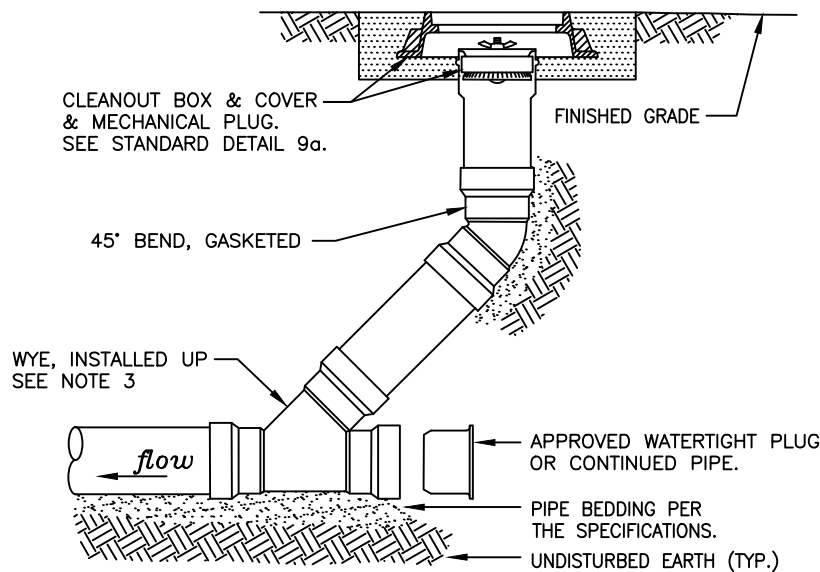

WYE CLEANOUT (INSIDE PROPERTY) PROFILE

**NOTES:**

1. SURFACE CLEANOUTS ARE REQUIRED AT THE R.O.W., CLEANOUTS LOCATED IN HARDSCAPE (SUCH AS SIDEWALKS, DRIVEWAYS, AND PATIOS), AND EVERY 100 FEET. THE SIDE SEWER CONNECTION AT THE MAIN LINE STUB SHALL BE A TWO-WAY CLEANOUT TEST TEE. SEE STANDARD DETAILS 7 & 8a.
2. A 2-WAY, DOUBLE SWEEP, TEST TEE IS REQUIRED TO BE INSTALLED AT EDGE OF EASEMENT OR EDGE OF PROPERTY LINE, SEE STANDARD DETAIL 7.
3. WYE SURFACE CLEANOUTS ARE TO BE INSTALLED EVERY 100' OR WHEN CLEANOUT IS IN HARDSCAPE WITHIN PROPERTY, SEE STANDARD DETAIL 9a. WYE IS NOT TO BE INSTALLED AT EDGE OF EASEMENT OR EDGE OF PROEPRTY LINE. ONLY EXCEPTION FOR INSTALLATION AT EDGE OF PROPERTY OR EDGE OF EASEMENT WILL BE IF WYE IS BEING INSTALLED FOR A GRINDER PUMP CONNECTION AS SHOWN ON STANDARD DETAIL 14d.
4. ALL PIPE MATERIAL SHALL BE BELL & SPIGOT TYPE WITH RUBBER GASKET JOINT AND SHALL BE IN CONFORMANCE WITH ASTM D3034 (SDR-35).

**SIDE SEWER SURFACE CLEANOUT**

NOT TO SCALE

**DETAIL APPROVALS**  
**EDITOR** TMC  
**MANAGER** SJD

**NORTHSHORE UTILITY DISTRICT**  
**2024 STANDARD SEWER DETAILS**

**9**

LAST UPDATED  
 JANUARY 2023